


TIM POWER - 10.560kW DC, 8.376kW AC

VICINITY MAP



AERIAL MAP

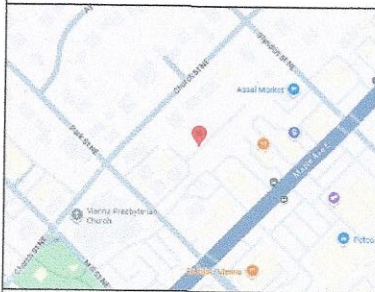

SHEET CATALOG

SHEET	REVISION	DESCRIPTION
CS-01	A	COVER SHEET
CS-02	A	GENERAL NOTES
E-01	A	SITE PLAN
E-01.1	A	SATELLITE VIEW
S-01	A	MOUNTING DETAILS
S-02	A	STRUCTURAL DETAILS
E-02	A	SINGLE LINE DIAGRAM
E-03	A	ELECTRICAL CALCULATIONS
PL-01	A	PLACARDS
SS	A	SPEC SHEET(S)

ROOF AREA CALCULATION

TOTAL ARRAY AREA	= 503.98 sq.ft
TOTAL ROOF AREA	= 2189 sq.ft
% ARRAY AREA IN ROOF	= 23.03 %

DESIGN CRITERIA

BASIC WIND SPEED	= 130 MPH @ 3-SEC GUST
GROUND SNOW LOAD	= 35 PSF
RISK CATEGORY	- II
PROJECT WINDSPEED DETERMINED USING THE ASCE 7 STANDARD UNLESS DIRECTED OTHERWISE BY LOCAL JURISDICTION AMENDMENTS	

SCOPE OF WORK

SYSTEM SIZE:	10560W DC, 8376W AC
MODULE:	(24)SILFAB SIL-440 QD (440W)
INVERTER:	(24)ENPHASE IQ8AC-72-M-US (240V)

BRANCH DETAILS:	1X8, 1X8, 1X8 ENPHASE BRANCHES
------------------------	--------------------------------

ENGINEERING SCOPE OF WORK

- ILLUMINE INTERNATIONAL INC. HAS ONLY PROVIDED DRAFTING SERVICES FOR THE PERMIT DRAWINGS. NO ACTUAL ENGINEERING WORK, ENGINEERING REVIEW OR ENGINEERING APPROVAL HAS BEEN CONDUCTED BY ILLUMINE INTERNATIONAL INC. UNLESS NOTED OTHERWISE.
- WHEN A PROFESSIONAL ENGINEER APPROVES AND SEALS THE DESIGN FOR COMPONENTS OF THEIR RESPECTIVE DISCIPLINE (STRUCTURAL/ELECTRICAL) SHOWN ON THESE PERMIT DRAWINGS, THE PROFESSIONAL ENGINEER
 - TAKES FULL DIRECT CONTROL OF THE ENGINEERED DESIGN
 - IS GIVEN ACCESS TO PERSONALLY SUPERVISE AND RECTIFY ANY ASPECT OF THE ENGINEERED DESIGN
 - HAS FULLY ACCEPTED RESPONSIBILITY FOR THE ENGINEERED DESIGN

GENERAL NOTES

- MODULES ARE LISTED UNDER UL 1703 / 61730 AND CONFORM TO THE STANDARDS.
- INVERTERS ARE LISTED UNDER UL 1741 AND CONFORM TO THE STANDARDS.
- DRAWINGS ARE DIAGRAMMATIC, INDICATING GENERAL ARRANGEMENT OF THE PV SYSTEM AND THE ACTUAL SITE CONDITION MIGHT VARY.
- WORKING CLEARANCES AROUND THE NEW PV ELECTRICAL EQUIPMENT WILL BE MAINTAINED IN ACCORDANCE WITH NEC 110.26.
- ALL GROUND WIRING CONNECTED TO THE MAIN SERVICE GROUNDING IN MAIN SERVICE PANEL/ SERVICE EQUIPMENT.
- ALL CONDUCTORS SHALL BE 600V, 90°C STANDARD COPPER UNLESS OTHERWISE NOTED.
- WHEN REQUIRED, A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- THE SYSTEM WILL NOT BE INTERCONNECTED BY THE CONTRACTOR UNTIL APPROVAL FROM THE LOCAL JURISDICTION AND/OR THE UTILITY.
- ROOF ACCESS POINT SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS OR DOORS, AND LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREES, WIRES OR SIGNS.
- PV ARRAY COMBINER/JUNCTION BOX PROVIDES TRANSITION FROM ARRAY WIRING TO CONDUIT WIRING.

Richard
Pantel

Digitally signed by
Richard Pantel
Date: 2025.10.10
04:08:49 -0400

APPLICABLE CODES

- ELECTRIC CODE: NEC 2020
- VIRGINIA STATEWIDE FIRE PREVENTION CODE: 2021 VSFPC
- VIRGINIA CONSTRUCTION CODE: 2021 VCC
- VIRGINIA RESIDENTIAL CODE: 2021 VRC WITH LOCAL AMENDMENTS

CUSTOMER INFORMATION

NAME: TIM POWER
ADDRESS: 119A PARK ST NE,
VIENNA, VA 22180

38.904714, -77.262950
APN: 0382710007
UTILITY: DOMINION ENERGY

AHJ: VA - COUNTY FAIRFAX

CONTRACTOR INFORMATION



DRAWING INFORMATION

PRN NUMBER: COS-1017707 REV: A
DRAFTED BY: WALEED
QC'ED BY: PARTHA S
SCALE: AS NOTED
PAPER SIZE: 17"x11"



INSTALLATION NOTES:

1. STRUCTURAL ROOF MEMBER LOCATIONS ARE ESTIMATED AND SHOULD BE LOCATED AND VERIFIED BY THE CONTRACTOR WHEN LAG BOLT PENETRATION OR MECHANICAL ATTACHMENT TO THE STRUCTURE IS REQUIRED.
2. ROOFTOP PENETRATIONS FOR SOLAR RACKING WILL BE COMPLETED AND SEALED WITH APPROVED SEALANT PER CODE BY A LICENSED CONTRACTOR.
3. LAGS MUST HAVE A MINIMUM 2.5" THREAD EMBEDMENT INTO THE STRUCTURAL MEMBER.
4. ALL PV RACKING ATTACHMENTS SHALL BE STAGGERED BY ROW BETWEEN THE ROOF FRAMING MEMBERS AS NECESSARY.
5. ROOF MOUNTED STANDARD RAIL REQUIRES ONE THERMAL EXPANSION GAP FOR EVERY RUN OF RAIL GREATER THAN 40'.
6. ALL CONDUCTORS AND CONDUITS ON THE ROOF SHALL BE MINIMUM 7/8" ABOVE THE ROOF SURFACE (INCLUDING CABLES UNDERNEATH MODULES AND RACKING).
7. ALL SOLAR PANEL ARRAY COMPONENTS SHALL BE INSTALLED PER THE MANUFACTURER'S APPROVED INSTALLATION SPECIFICATIONS.
8. THE EXISTING BUILDINGS STRUCTURE SHALL BE VERIFIED AS PROPERLY CONSTRUCTED AND MAINTAINED IN GOOD CONDITION. NO ALLOWANCE HAS BEEN MADE IN THESE DRAWINGS FOR ANY EXISTING DEFICIENCY IN DESIGN, MATERIAL, CONSTRUCTION, OR LACK OF MAINTENANCE FOR THE EXISTING STRUCTURE OR PROPOSED EQUIPMENT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD VERIFYING EXISTING CONDITIONS, PROPER FIT, AND CLEARANCES IN THE FIELD.
9. WATERPROOFING AROUND THE ROOF PENETRATIONS IS THE RESPONSIBILITY OF CONTRACTOR/INSTALLER.
10. MISCELLANEOUS ITEMS NOT EXPLICITLY LISTED OR IDENTIFIED IN THESE DRAWINGS HAVE NOT BEEN DESIGNED. IT IS RECOMMENDED THAT MATERIAL OF SUITABLE SIZE STRENGTH TO BE OBTAINED FROM A REPUTABLE MANUFACTURER FOR MISCELLANEOUS ITEMS.
11. IF PROJECT IS STAMPED AND SEALED BY AN ILLUMINE-I STRUCTURAL ENGINEER, SEE ASSOCIATED ILLUMINE-I STRUCTURAL REPORT FOR FULL COMPREHENSIVE SCOPE OF STRUCTURAL ENGINEERING INVESTIGATION AND APPROVAL.
12. IF ANY CONDITION THROUGHOUT THE ASSOCIATED REPORT OR PERMIT DRAWINGS IS NOT ALSO REPRESENTED ON-SITE, CONTRACTOR SHALL NOTIFY THE ENGINEER OF RECORD OF ANY DISCREPANCIES AND RECEIVE WRITTEN APPROVAL FROM THE ENGINEER OF RECORD BEFORE PROCEEDING WITH INSTALLATION.
13. CONTRACTOR TO PROVIDE MINIMUM 1/4" GAP BETWEEN ALL SOLAR PANELS.

ROOF ACCESS PATHWAYS AND SETBACKS:**1205.2.1 SOLAR PHOTOVOLTAIC SYSTEMS FOR GROUP R-3 BUILDINGS:**

SOLAR PHOTOVOLTAIC SYSTEMS FOR GROUP R-3 BUILDINGS SHALL COMPLY WITH SECTIONS 1205.2.1.1 THROUGH 1205.2.1.3.

EXCEPTIONS:

1. THESE REQUIREMENTS SHALL NOT APPLY TO STRUCTURES DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH THE INTERNATIONAL RESIDENTIAL CODE.
2. THESE REQUIREMENTS SHALL NOT APPLY TO ROOFS WITH SLOPES OF 2 UNITS VERTICAL IN 12 UNITS HORIZONTAL (16.7-PERCENT) OR LESS.

1205.2.1.1 PATHWAYS TO RIDGE:

NOT FEWER THAN TWO 36-INCH-WIDE (914 MM) PATHWAYS ON SEPARATE ROOF PLANES, FROM LOWEST ROOF EDGE TO RIDGE, SHALL BE PROVIDED ON ALL BUILDINGS. NOT FEWER THAN ONE PATHWAY SHALL BE PROVIDED ON THE STREET OR DRIVEWAY SIDE OF THE ROOF. FOR EACH ROOF PLANE WITH A PHOTOVOLTAIC ARRAY, NOT FEWER THAN ONE 36-INCH-WIDE (914 MM) PATHWAY FROM LOWEST ROOF EDGE TO RIDGE SHALL BE PROVIDED ON THE SAME ROOF PLANE AS THE PHOTOVOLTAIC ARRAY, ON AN ADJACENT ROOF PLANE OR STRADDLING THE SAME AND ADJACENT ROOF PLANES

1205.2.1.2 SETBACKS AT RIDGE:

FOR PHOTOVOLTAIC ARRAYS OCCUPYING 33 PERCENT OR LESS OF THE PLAN VIEW TOTAL ROOF AREA, A SETBACK OF NOT LESS THAN 18 INCHES (457 MM) WIDE IS REQUIRED ON BOTH SIDES OF A HORIZONTAL RIDGE. FOR PHOTOVOLTAIC ARRAYS OCCUPYING MORE THAN 33 PERCENT OF THE PLAN VIEW TOTAL ROOF AREA, A SETBACK OF NOT LESS THAN 36 INCHES (457 MM) WIDE IS REQUIRED ON BOTH SIDES OF A HORIZONTAL RIDGE.

1205.2.1.3 ALTERNATIVE SETBACKS AT RIDGE:

WHERE AN AUTOMATIC SPRINKLER SYSTEM IS INSTALLED WITHIN THE DWELLING IN ACCORDANCE WITH SECTION 903.3.1.3, SETBACKS AT THE RIDGE SHALL CONFORM TO ONE OF THE FOLLOWING:


1. FOR PHOTOVOLTAIC ARRAYS OCCUPYING 66 PERCENT OR LESS OF THE PLAN VIEW TOTAL ROOF AREA, A SETBACK OF NOT LESS THAN 18 INCHES (457 MM) WIDE IS REQUIRED ON BOTH SIDES OF A HORIZONTAL RIDGE.
2. FOR PHOTOVOLTAIC ARRAYS OCCUPYING MORE THAN 66 PERCENT OF THE PLAN VIEW TOTAL ROOF AREA, A SETBACK OF NOT LESS THAN 36 INCHES (914 MM) WIDE IS REQUIRED ON BOTH SIDES OF A HORIZONTAL RIDGE.

1205.2.2 EMERGENCY ESCAPE AND RESCUE OPENINGS. PANELS AND MODULES INSTALLED ON GROUP R-3 BUILDINGS SHALL NOT BE PLACED ON THE PORTION OF A ROOF THAT IS BELOW AN EMERGENCY ESCAPE AND RESCUE OPENING. A PATHWAY OF NOT LESS THAN 36 INCHES (914 MM) WIDE SHALL BE PROVIDED TO THE EMERGENCY ESCAPE AND RESCUE OPENING.

CUSTOMER INFORMATION		CONTRACTOR INFORMATION	
NAME: TIM POWER ADDRESS: 119A PARK ST NE, VIENNA, VA 22180 38.904714, -77.262950 APN: 0382710007 UTILITY: DOMINION ENERGY AHJ: VA - COUNTY FAIRFAX		 CONVERT SOLAR <i>Benefits Beyond the Bottom Line</i>	
DRAWING INFORMATION			
PRN NUMBER: COS-1017707 REV: A DRAFTED BY: WALEED QC'ED BY: PARTHA S SCALE: AS NOTED PAPER SIZE: 17"x11"		 ILLUMINE i GENERAL NOTES DATE: 10/08/2025 SHEET: CS-02	

TIM POWER - 10.560kW DC, 8.376kW AC

NOTE: NO GATE AND FENCE

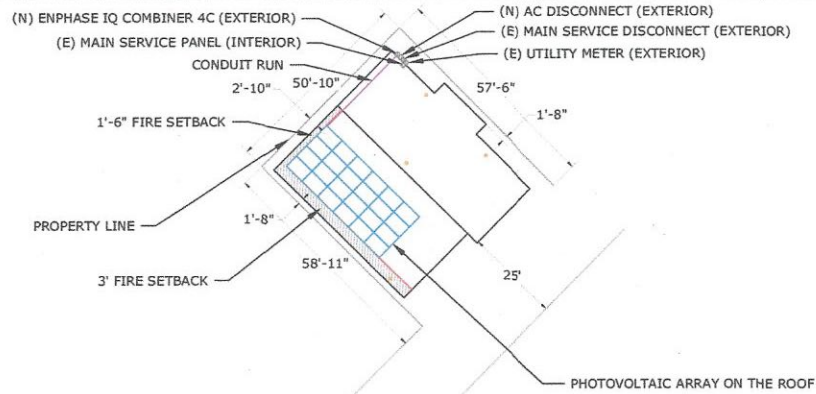

ROOF AREA CALCULATION

TOTAL ARRAY AREA	= 503.98 sq.ft
TOTAL ROOF AREA	= 2189 sq.ft
% ARRAY AREA IN ROOF	= 23.03 %

CUSTOMER INFORMATION CONTRACTOR INFORMATION

NAME: TIM POWER
ADDRESS: 119A PARK ST NE,
VIENNA, VA 22180
38.904714, -77.262950
APN: 0382710007
UTILITY: DOMINION ENERGY
AHJ: VA - COUNTY FAIRFAX



DRAWING INFORMATION

PRN NUMBER: COS-1017707 REV: A
DRAFTED BY: WALEED
QC'ED BY: PARTHA S
SCALE: AS NOTED
PAPER SIZE: 17"X11"

ILLUMINE i
SITE PLAN
DATE: 10/08/2025 SHEET: E-01



SCALE: 1"= 30'-0"



CUSTOMER INFORMATION	CONTRACTOR INFORMATION
----------------------	------------------------


NAME: TIM POWER ADDRESS: 119A PARK ST NE, VIENNA, VA 22180 38.904714, -77.262950 APN: 0382710007 UTILITY: DOMINION ENERGY AHJ: VA - COUNTY FAIRFAX	 CONVERT SOLAR <i>Benefits Beyond the Bottom Line</i>
--	--

DRAWING INFORMATION

PRN NUMBER: COS-1017707 REV: A DRAFTED BY: WALEED QC'ED BY: PARTHA S SCALE: AS NOTED PAPER SIZE: 17"X11"
--

 ILLUMINE i SATELLITE VIEW DATE: 10/08/2025 SHEET: E-01.1
--

NOTE: PENETRATIONS ARE STAGGERED

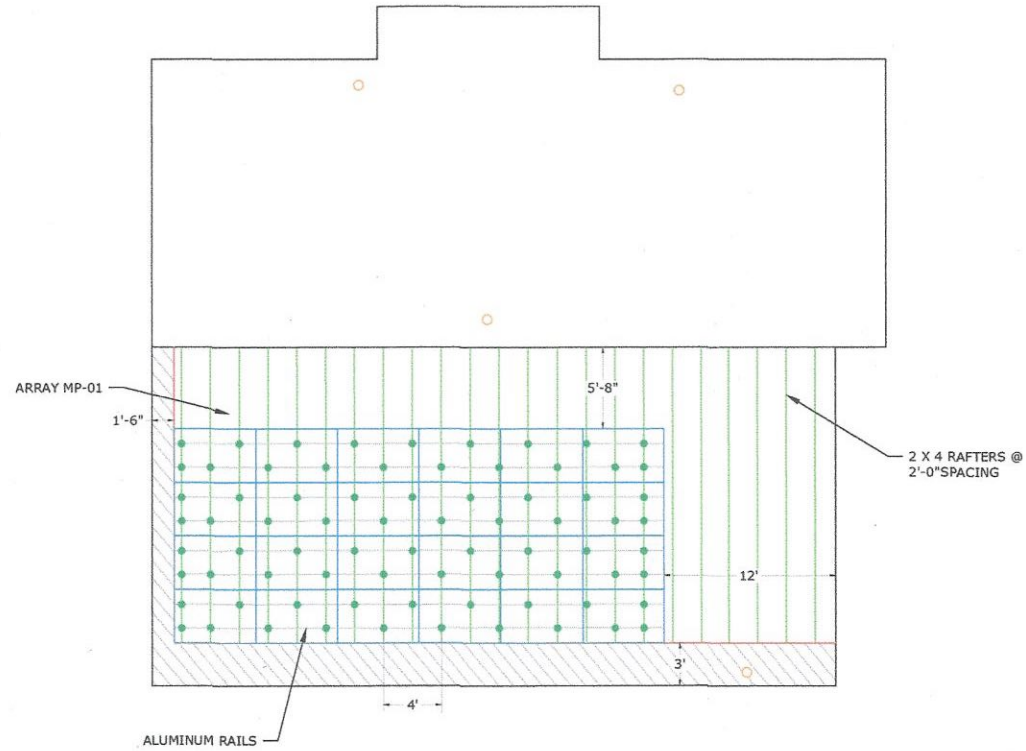

SCALE: 1/8" = 1'-0"

ROOF AREA CALCULATION

TOTAL ARRAY AREA	= 503.98 sq.ft
TOTAL ROOF AREA	= 2189 sq.ft
% ARRAY AREA IN ROOF	= 23.03 %

SITE INFORMATION

S.NO	AZIMUTH	PITCH	NO. OF MODULES	ARRAY AREA (SQ. FT.)	ROOF TYPE	ATTACHMENT	ROOF EXPOSURE	FRAME TYPE	FRAME SIZE	FRAME SPACING	MAX RAIL SPAN	OVER HANG
MP-01	225°	0°	24	503.98	EPDM MEMBRANE	QUICKMOUNT HALO ULTRAGRIP (FRAMING MOUNT)	ATTIC	RAFTERS	2 X 4	2'-0"	4'-0"	1'-6"

CUSTOMER INFORMATION

NAME: TIM POWER
ADDRESS: 119A PARK ST NE,
VIENNA, VA 22180

38.904714, -77.262950
APN: 0382710007
UTILITY: DOMINION ENERGY
AHJ: VA - COUNTY FAIRFAX

CONTRACTOR INFORMATION




DRAWING INFORMATION

PRN NUMBER: COS-1017707 REV: A
DRAFTED BY: WALEED
QC'ED BY: PARTHA S
SCALE: AS NOTED
PAPER SIZE: 17"X11"



DC SYSTEM SIZE- 10560W, AC SYSTEM SIZE - 8376W

NOTE:
EACH MICROINVERTER IS RAPID SHUTDOWN COMPLIANT

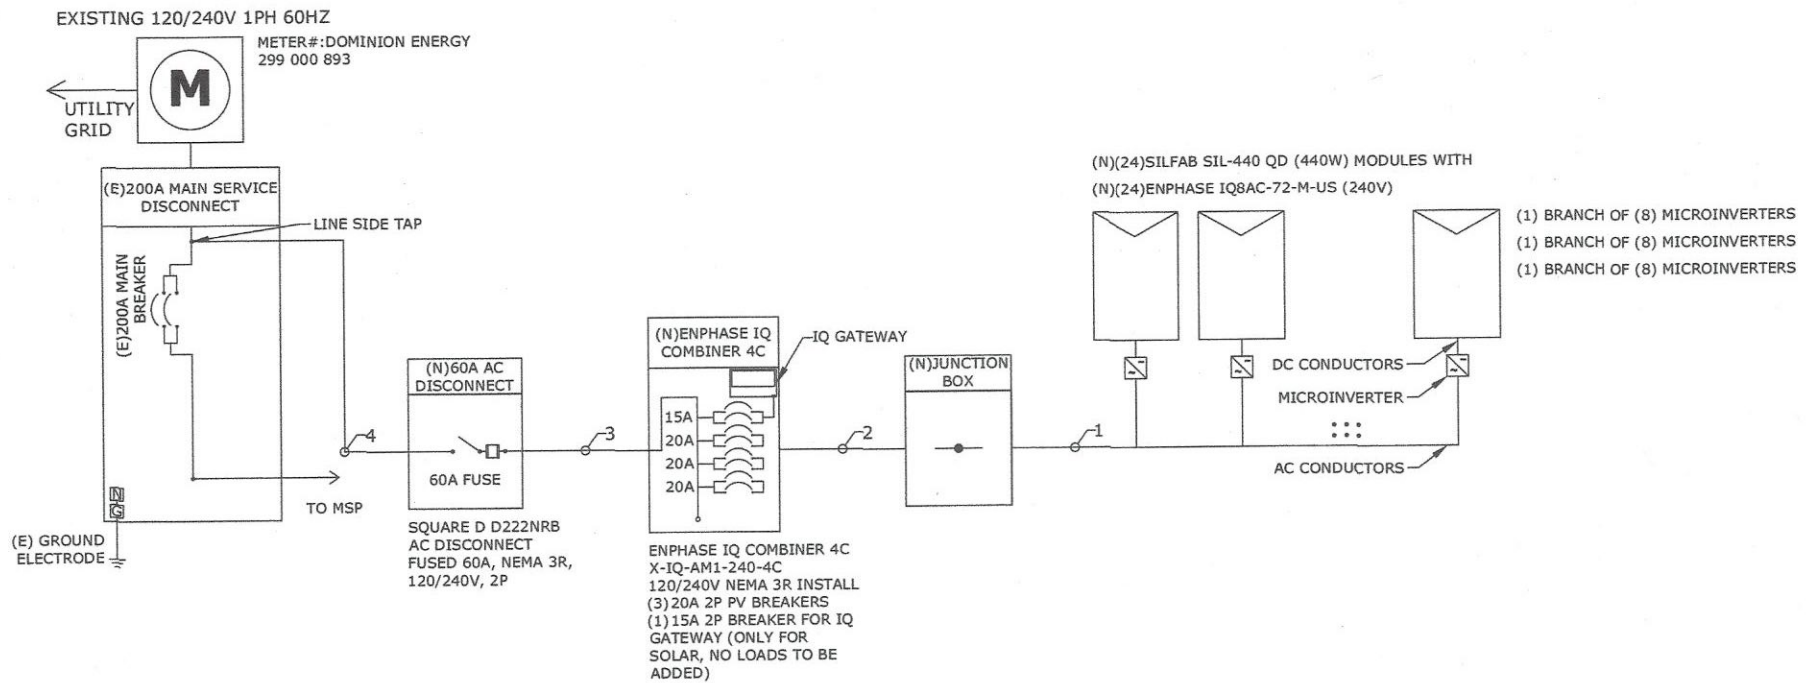

CONDUCTOR AND CONDUIT SCHEDULE

TAG ID	CONDUIT SIZE	CONDUCTOR	NEUTRAL	GROUND
1	NONE	(2) 12 AWG ENPHASE Q CABLE PER BRANCH CIRCUIT	NONE	(1) 6 AWG BARE COPPER
2	METALLIC CONDUIT	(6) 10 AWG THHN/THWN-2	NONE	(1) 8 AWG THHN/THWN-2
3	CONDUIT	(2) 6 AWG THHN/THWN-2	(1) 6 AWG THHN/THWN-2	(1) 8 AWG THHN/THWN-2
4	CONDUIT	(2) 6 AWG THHN/THWN-2	(1) 6 AWG THHN/THWN-2	(1) 6 AWG THHN/THWN-2

CUSTOMER INFORMATION CONTRACTOR INFORMATION

NAME: TIM POWER
ADDRESS: 119A PARK ST NE,
VIENNA, VA 22180
38.904714, -77.262950
APN: 0382710007
UTILITY: DOMINION ENERGY
AHJ: VA - COUNTY FAIRFAX



DRAWING INFORMATION

PRN NUMBER: COS-1017707 REV: A
DRAFTED BY: WALEED
QC'ED BY: PARTHA S
SCALE: AS NOTED
PAPER SIZE: 17"X11"



DC SYSTEM SIZE- 10560W, AC SYSTEM SIZE - 8376W

MODULE SPECIFICATION

MODEL	SILFAB SIL-440 QD (440W)
MODULE POWER @ STC	440 W
OPEN CIRCUIT VOLTAGE:V _{oc}	38.97 V
MAX POWER VOLTAGE:V _{mp}	33.41 V
SHORT CIRCUIT CURRENT:I _{sc}	14.22 A
MAX POWER CURRENT:I _{mp}	13.17 A

MICROINVERTER SPECIFICATIONS

MODEL	ENPHASE IQ8AC-72-M-US (240V)
POWER RATING	349W
MAX. CONTINUOUS OUTPUT CURRENT	1.45A
CEC WEIGHTED EFFICIENCY	97%
MAX NO OF MICROINVERTERS / BRANCH	11
MAX DC VOLTAGE	60V

WIRE SIZE CALCULATIONS

TAG 1: (AC)	
REQUIRED CONDUCTOR AMPACITY (1.45 * 8 * 1.25)	= 14.5 A
CORRECTED AMPACITY CALCULATION (0.91 * 1 * 30)	= 27.3 A
14.5A < 27.3A	
TAG 2: (AC)	
REQUIRED CONDUCTOR AMPACITY (1.45 * 8 * 1.25)	= 14.5 A
CORRECTED AMPACITY CALCULATION (0.91 * 0.8 * 40)	= 29.12 A
14.5A < 29.12A	
TAG 3: (AC)	
REQUIRED CONDUCTOR AMPACITY (1.45 * 24 * 1.25)	= 43.5 A
CORRECTED AMPACITY CALCULATION (0.91 * 1 * 75)	= 68.25 A
43.5A < 68.25A	
TAG 4: (AC)	
REQUIRED CONDUCTOR AMPACITY (1.45 * 24 * 1.25)	= 43.5 A
CORRECTED AMPACITY CALCULATION (0.91 * 1 * 75)	= 68.25 A
43.5A < 68.25A	

AC WIRE SIZING CALCULATIONS BASED ON FOLLOWING EQUATIONS

REQUIRED CONDUCTOR AMPACITY:
 INVERTER OUTPUT CURRENT * #OF INVERTERS = MAX CURRENT PER 690.8(A)(1)(e) * 125%
 = MAX CURRENT PER 690.8(B)(1)

CORRECTED AMPACITY CALCULATIONS:
 DERATED CONDUCTOR AMPACITY PER 690.8(B)(2) = AMPACITY * TEMPERATURE DERATE FACTOR *
 CONDUIT FILL DERATE

DERATED CONDUCTOR AMPACITY CHECK: MAX CURRENT PER 690.8(B)(1) < DERATED CONDUCTOR AMPACITY

ELECTRICAL NOTES

- CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC 310.10(C).
- CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC 310.10(D).
- MAXIMUM DC/AC VOLTAGE DROP SHALL BE NO MORE THAN 2%.
- ALL CONDUCTORS SHALL BE IN CONDUIT UNLESS OTHERWISE NOTED.
- BREAKER/FUSES SIZED ACCORDING PER NEC ARTICLE 240.
- AC GROUNDING ELECTRODE CONDUCTOR (GEC) SIZED PER NEC 250.66.
- EQUIPMENT GROUNDING CONDUCTOR (EGC) SIZED PER NEC 250.122.
- AMBIENT TEMPERATURE ADJUSTMENT FACTOR IS BASED ON TABLE NEC 310.15(B)(1).
- CURRENT CARRYING CONDUCTOR ADJUSTMENT FACTOR IS BASED ON NEC 310.15(C)(1).
- MAX. SYSTEM VOLTAGE CORRECTION IS PER NEC 690.7.
- CONDUCTORS ARE SIZED PER NEC 310.16.

OCPD CALCULATION

ALLOWABLE BACKFEED:

MAIN SERVICE DISCONNECT RATING = 200 A
 MAIN SERVICE DISCONNECT BREAKER RATING = 200 A
 LINE SIDE TAP 100% OF ALLOWABLE BACKFEED = 200 A

INVERTER OVERCURRENT PROTECTION:

INVERTER OVERCURRENT PROTECTION = (MICROINVERTER O/P CURRENT * # OF MICROINVERTERS * CONTINUOUS LOAD(1.25))
 = (1.45 * 24 * 1.25)
 = 43.5 A
 PV BREAKER SIZE / FUSE SIZE = 60 A ≥ 43.5 A

TOTAL REQUIRED PV BREAKER SIZE / FUSE SIZE = 60 A PV BREAKER / FUSE SIZE

CUSTOMER INFORMATION

NAME: TIM POWER
 ADDRESS: 119A PARK ST NE,
 VIENNA, VA 22180

38.904714, -77.262950
 APN: 0382710007
 UTILITY: DOMINION ENERGY

AHJ: VA - COUNTY FAIRFAX

CONTRACTOR INFORMATION



DRAWING INFORMATION

PRN NUMBER: COS-1017707 REV: A
 DRAFTED BY: WALEED
 QC'D BY: PARTHA S
 SCALE: AS NOTED
 PAPER SIZE: 17"x11"

ILLUMINE i
ELECTRICAL CALCULATIONS
 DATE: 10/08/2025 SHEET: E-03

AC RACEWAYS	
1	
SW-1 DISCONNECT (SQUARE D DZZ2NRB)	
1	3
MSP - MAIN SERVICE PANEL	
1	2
UTILITY METER	
2	

LABELING NOTES	
1	ALL PLAQUES AND SIGNAGE REQUIRED BY 2020 NEC AND 2021 VSFPC WILL BE INSTALLED AS REQUIRED
2	LABELS, WARNING(S) AND MARKING SHALL COMPLY WITH ANSI Z535.4, WHICH REQUIRES THAT DANGER WARNING, AND CAUTION SIGNS USED THE STANDARD HEADER COLORS, HEADER TEXT AND SAFETY ALERT SYMBOL ON EACH LABEL. THE ANSI STANDARD REQUIRES A HEADING THAT IS AT LEAST 50% TALLER THAN THE BODY TEXT, IN ACCORDANCE WITH NEC 110.21(B).
3	A PERMANENT PLAQUE OR DIRECTORY SHALL BE INSTALLED PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS IF NOT IN THE SAME LOCATION IN ACCORDANCE WITH NEC 690.56(B).
4	LABEL(S) WITH MARKING, "WARNING PHOTOVOLTAIC POWER SOURCE, "SHALL BE LOCATED AT EVERY 10 FEET OF EACH DC RACEWAY AND WITH IN ONE FOOT OF EVERY TURN OR BEND AND WITH IN ONE FOOT OF EVERY TURN OR BEND AND WITH IN ONE FOOT ABOVE AND BELOW ALL PENETRATIONS OF ROOF/CEILING ASSEMBLIES, WALLS AND BARRIERS. THE LABEL SHALL HAVE 3/8" TALL LETTERS AND BE REFLECTIVE WITH WHITE TEXT ON A RED BACKGROUND

1



2







3



CUSTOMER INFORMATION	CONTRACTOR INFORMATION
NAME: TIM POWER ADDRESS: 119A PARK ST NE, VIENNA, VA 22180 38.904714, -77.262950 APN: 0382710007 UTILITY: DOMINION ENERGY AHJ: VA - COUNTY FAIRFAX	
DRAWING INFORMATION	
PRN NUMBER: COS-1017707 REV: A DRAFTED BY: WALEED QC'ED BY: PARTHA S SCALE: AS NOTED PAPER SIZE: 17"x11"	
	
PLACARDS DATE: 10/08/2025 SHEET: PL-01	

DEAD LOAD CALCULATIONS			
BOM	QUANTITY	LBS/UNIT	TOTAL WEIGHT (LBS)
MODULES	24	46.3	1111.2
MID-CLAMP	40	0.05	2
END-CLAMP	16	0.05	0.8
RAIL LENGTH	275	0.43	118.25
SPLICE BAR	16	0.36	5.76
QUICKMOUNT HALO ULTRAGRIP (FRAMING MOUNT)	76	0.57	43.32
MICROINVERTERS	24	2.43	58.32
TOTAL WEIGHT OF THE SYSTEM (LBS)			1339.65
TOTAL ARRAY AREA ON THE ROOF (SQ. FT.)			503.98
WEIGHT PER SQ. FT.(LBS)			2.66
WEIGHT PER PENETRATION (LBS)			17.63

MODULE DATA	
SILFAB SIL-440 QD (440W)	
MODULE DIM	67.8"x44.6"x1.37"
WOOD SCREWS	(2) #14 X 3" RD STRUCTURAL WOOD SCREWS W/ EPDM SEALING WASHER, 2.5" MIN EMBEDMENT TO RAFTER / TRUSS TOP CHORD

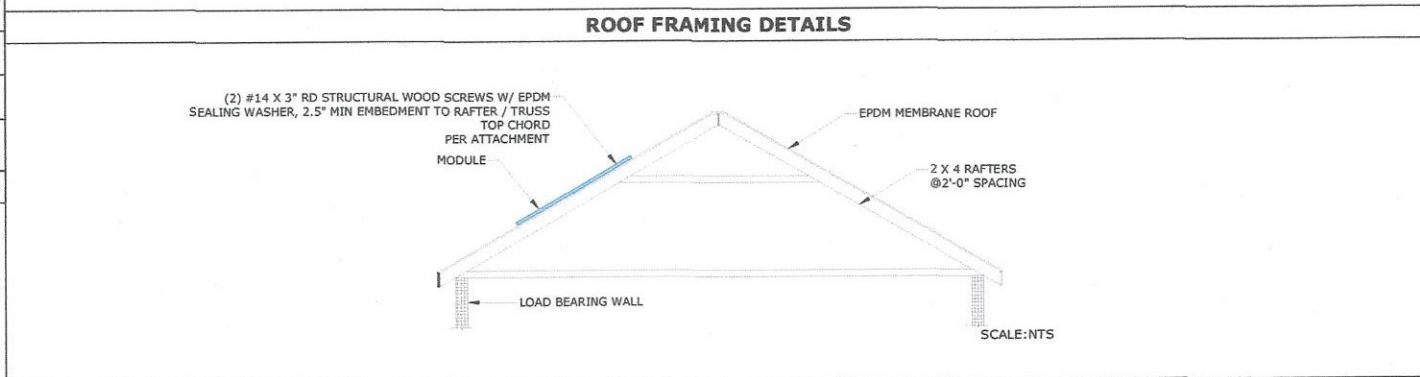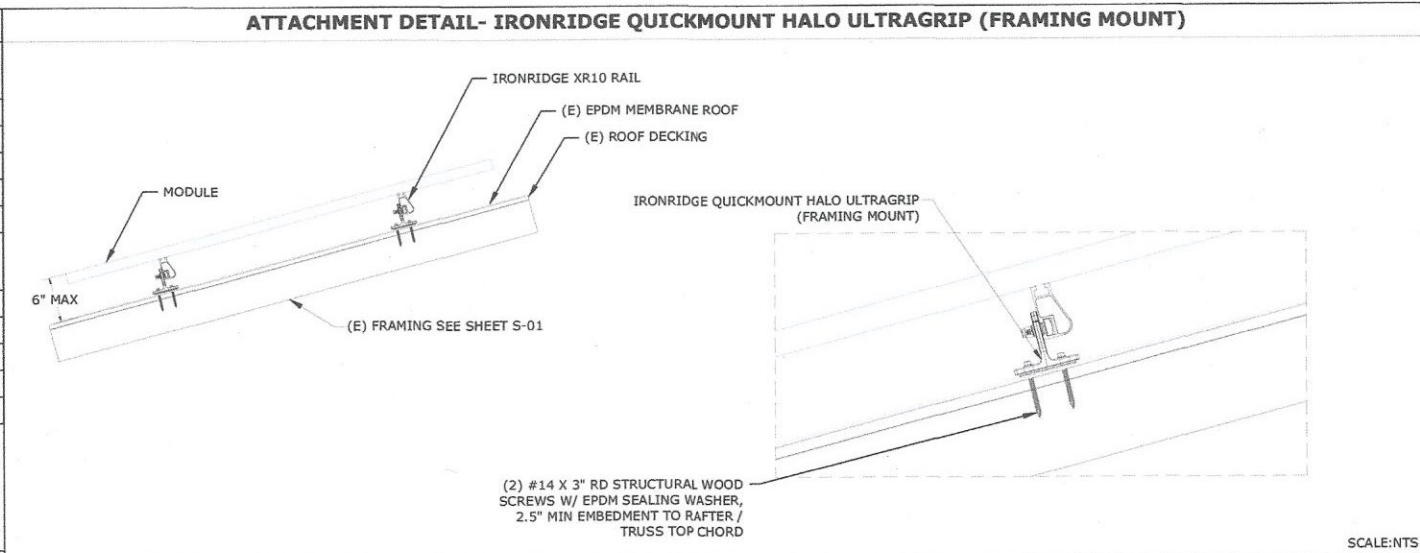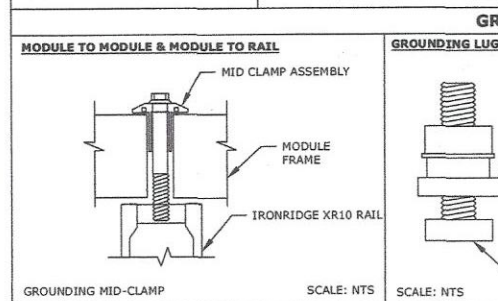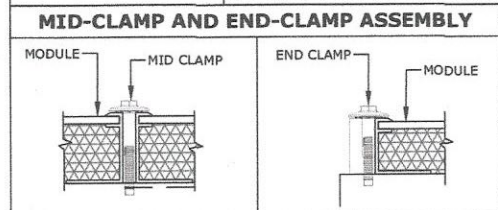

GROUNDING DETAILS		CUSTOMER INFORMATION		CONTRACTOR INFORMATION	
RAIL TO RAIL The diagram shows the rail to rail assembly. It includes labels for the self-drilling screw, ironridge xr10 rail, and ironridge internal splice. The scale is NTS.		NAME: TIM POWER ADDRESS: 119A PARK ST NE, VIEWNA, VA 22180 38.904714, -77.262950 APN: 0382710007 UTILITY: DOMINION ENERGY AHJ: VA - COUNTY FAIRFAX		CONVERT SOLAR Benefits Beyond the Bottom Line	
DRAWING INFORMATION PRN NUMBER: COS-1017707 REV: A DRAFTED BY: WALEED QC'ED BY: PARTHA S SCALE: AS NOTED PAPER SIZE: 17"x11"		ILLUMINE i STRUCTURAL DETAILS DATE: 10/08/2025 SHEET: S-02			

MODULE SPEC SHEET

SILFAB PRIME NTC

SIL-440 QD

SILFAB SOLAR®



NEXT-GENERATION N-TYPE CELL TECHNOLOGY

- Improved Shade Tolerance
- Improved Low-Light Performance
- Increased Performance in High Temperatures
- Enhanced Durability
- Reduced Degradation Rate
- 25-Year Product Warranty/30-Year Performance Warranty



ELECTRICAL SPECIFICATIONS		440	
Test Conditions		STC	NOCT
Module Power (P _{max})	Wp	440	328.0
Maximum power voltage (V _{mp})	V	35.41	31.17
Maximum power current (I _{mp})	A	13.17	10.52
Open circuit voltage (V _{oc})	V	36.97	30.64
Short circuit current (I _{sc})	A	14.22	11.44
Module efficiency	%	22.6%	
Maximum system voltage (VDC)	V	1000	
Series fuse rating	A	25	
Power Tolerance	Wp	0 to +10	


Measurement conditions: STC 1000 W/m² • AM 1.5 • Temperature 25 °C • NOCT 800 W/m² • AM 1.5 • Measurement uncertainty ± 3%
 Sun simulator calibration reference modules from Fraunhofer Institute. Electrical characteristics may vary by ±5% and power by 6 to +10 W.

MECHANICAL PROPERTIES / COMPONENTS		METRIC	IMPERIAL
Module weight		21 kg ± 0.2 kg	46.3 lbs ± 0.4 lbs
Dimensions (H x L x D)		1721 mm x 1133 mm x 35 mm	67.8 in x 44.6 in x 1.37 in
Maximum surface load (wind/snow)*		4000 Pa rear load / 5400 Pa front load	83.5 lb/ft ² rear load / 112.8 lb/ft ² front load
Hail impact resistance		25 mm at 83 km/h	1 in at 51.6 mph
Cells		108 Half cells - N-Type Silicon solar cell	108 Half cells - N-Type Silicon solar cell
		182 mm x 91 mm	7.16 in x 3.58 in
Glass		3.2 mm high transmittance, tempered, antireflective coating	0.126 in high transmittance, tempered, antireflective coating
Cables and connectors (refer to installation manual)		1350 mm, 6.5 mm, MC4 from Staubli	53.1 in, 0.22 in (12 AWG), MC4 from Staubli
Backsheet		High durability, superior hydrolysis and UV resistance, multi-layer dielectric film, fluorine-free PV backsheet	
Frame		Anodized aluminum (Black)	
Junction Box		UL 1730 Certified, IEC 62790 Certified, IP68 rated, 3 diodes	

TEMPERATURE RATINGS		WARRANTIES	
Temperature Coefficient I _{sc}	0.04 %/°C	Module product workmanship warranty	25 years**
Temperature Coefficient V _{oc}	-0.24 %/°C	Linear power performance guarantee	32 years
Temperature Coefficient P _{max}	-0.20 %/°C		
NOCT (± 2 °C)	45 °C		
Operating temperature	-40/+85 °C		

CERTIFICATIONS		SHIPPING SPECS	
Product	UL 61215, UL 61730, CSA C22.2 #61730, IEC 61215, IEC 61730, IEC 61701 (Salt Mist Corrosion), IEC 62716 (Ammonia Corrosion), CEC Listed, UL Fire Rating: Type 2	Modules Per Pallet	26 or 26 (California)
Factory	ISO 9001:2015	Pallets per Truck	32 or 30 (California)
		Modules Per Truck	832 or 780 (California)

* Warning: Read the Safety and Installation Manual for mounting specifications and before handling, installing and operating modules.
 ** 12 year extendable to 25 years subject to registration and conditions outlined under "Warranty" at silfab.com.
 PNM files generated from 3rd party performance data are available for download at: silfab.com/downloads.

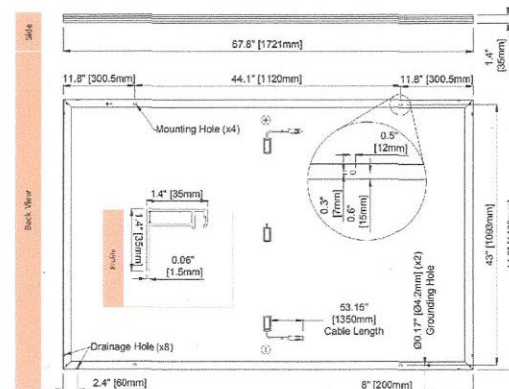

SILFAB SOLAR INC.

1770 Port Drive
 Burlington WA 98233 USA
 T +1 360 569 4733
 info@silfab.com
 SILFABSOLAR.COM
 7149 Logistics Lane
 Mississauga ON L5T 2Y3 Canada
 T +1 888 400 4338
 240 Courteneypark Drive East
 Mississauga ON L5T 2Y3 Canada
 T +1 905 256 2501
 F +1 905 696 0207

Silfab - SIL-440-QD-28240829

No reproduction of any kind is allowed without permission.
 Data and information is subject to modifications without
 notice. © Silfab Solar Inc. 2024. Silfab Solar Inc. is a registered
 trademark of Silfab Solar Inc.

INVERTER SPEC SHEET




NORTH AMERICA DATA SHEET

IQ8AC Microinverter

Our newest IQ8 Series Microinverters^{1,2,3} are the industry's first microgrid-forming⁴, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently.



Key specifications	IQ8AC-72-M-US @240 VAC	IQ8AC-72-M-US @208 VAC
Peak output power	366 VA	350 VA
Nominal grid voltage (L-L)	240 V split-phase (L-L), 180°	208 V single-phase (L-L), 120°
Nominal frequency	60 Hz	60 Hz
CEC weighted efficiency	97.0%	96.5%
Maximum input DC voltage	60 V	60 V
MPPT voltage range	28-45 V	28-45 V
Maximum module I_{sc}	20 A	20 A
Ambient temperature range	-40°C to 65°C (-40°F to 149°F)	

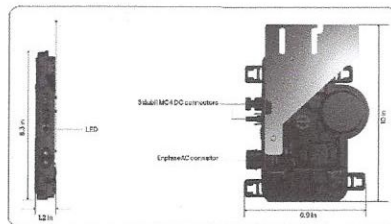

Simple

- Lightweight and compact with plug-and-play connectors
- Power line communication (PLC) between components
- Faster installation with simple two-wire cabling

Reliable

- Produces power even when the grid is down⁴
- More than one million cumulative hours of testing
- Industry-leading limited warranty of up to 25 years
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

Microgrid-forming

- Complies with the latest advanced grid support
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) and IEEE 1547:2018 (UL 1741-SB 3rd Ed.)

¹ IQ8 Series Microinverters can be added to existing IQ7 systems on the same IQ Gateway only in the following grid-tied configurations: Solar Only or Solar + Battery (IQ Battery 3T/10T and IQ Battery 5P) without backup.
² IQ7 Series Microinverters cannot be added to a site with existing IQ8 Series Microinverters on the same gateway.
³ Microsystem of IQ7 and IQ8 will not support IQ8-specific PCS features and grid-forming capabilities.
⁴ IQ Microinverters ship with default settings that meet North America's IEEE 1547 interconnection standard requirements. Region-specific adjustments may be requested by an Authority Having Jurisdiction (AHJ) or utility representative, according to the IEEE 1547 interconnection standard. Use an IQ Gateway to make these changes during installation.

⁵ Meets UL 1741 only when installed with IQ System Controller 2 or 3.

© 2024 Enphase Energy. All rights reserved. Enphase, the e and i logos, IQ, and certain other marks listed at <https://enphase.com/legal/brand-usage-guidelines> are trademarks of Enphase Energy, Inc. in the U.S. and/or other countries. Data subject to change.

064-00046-0-01-019-2024-12-10

Input data (DC)	Units	IQ8AC-72-M-US
Commonly used module pairings ⁵	W	295-500
Module compatibility	—	To meet compatibility, PV modules must be within the following maximum input DC voltage and maximum module I_{sc} . Module compatibility can be checked at https://enphase.com/installers/microinverters/calculator .
MPPT voltage range	V	28-45
Operating range	V	18-58
Minimum/Maximum start voltage	V	22/58
Maximum input DC voltage	V	60
Maximum continuous input DC current	A	14
Maximum input DC short-circuit current	A	25
Maximum module I_{sc}	A	20
Overvoltage class DC port	—	II
DC port backfeed current	mA	0
PV array configuration	—	Ungrounded array; no additional DC side protection required; AC side protection requires a maximum of 20 A per branch circuit

Output data (AC)	Units	IQ8AC-72-M-US @240 VAC	IQ8AC-72-M-US @208 VAC
Peak output power	VA	366	350
Maximum continuous output power	VA	349	345
Nominal grid voltage (L-L)	V	240, split-phase (L-L), 180°	208, single-phase (L-L), 120°
Minimum and maximum grid voltage ⁶	V	211-264	183-229
Maximum continuous output current	A	1.45	1.66
Nominal frequency	Hz		60
Extended frequency range	Hz		47-68
AC short-circuit fault current over three cycles	A _{rms}		2.70
Maximum units per 20 A (L-L) branch circuit ⁷	—	11	9
Total harmonic distortion	%		<5
Overvoltage class AC port	—		III
AC port backfeed current	mA		18
Power factor setting	—		1.0
Grid-tied power factor (adjustable)	—		0.85 leading ... 0.85 lagging
Peak efficiency	%	97.3	97.2
CEC weighted efficiency	%	97.0	96.5
Nighttime power consumption	mW	30	22

Mechanical data	IQ8AC-72-M-US
Ambient temperature range	-40°C to 65°C (-40°F to 149°F)
Relative humidity range	4% to 100% (condensing)
DC connector type	Stübel MC4

⁵ No enforced DC/AC ratio.

⁶ Nominal voltage range can be extended beyond nominal if required by the utility.


⁷ Units may vary due to local requirements to define the number of microinverters per branch in your area.

064-00046-0-01-019-2024-12-10

COMBINER SPEC SHEET



DATA SHEET

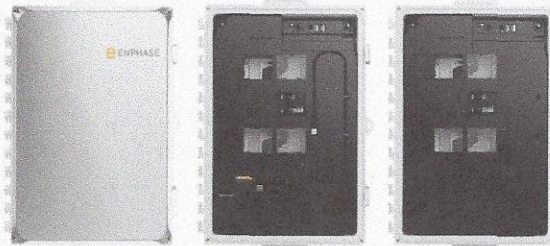

X-IQ-AM1-240-4
X2-IQ-AM1-240-4
(IEEE 1547:2018)
X-IQ-AM1-240-4C
X2-IQ-AM1-240-4C
(IEEE 1547:2018)

IQ Combiner 4/4C

The Enphase IQ Combiner 4/4C with IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ Microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and an Eaton BR series busbar assembly.



IQ Series Microinverters
The high-powered smart grid-ready IQ Series Microinverters (IQ6, IQ7, and IQ8 Series) dramatically simplify the installation process.



IQ System Controller 2
Provides microgrid interconnection device (MID) functionality by automatically detecting grid failures and seamlessly transitioning the home energy system from grid power to backup power.



IQ Battery
All-in-one AC coupled storage system that is reliable, smart, simple, and safe. It provides backup capability, and installers can quickly design the right system size to meet the needs of both new and retrofit solar customers.



IQ Load Controller
Helps prioritize essential appliances during a grid outage to optimize energy consumption and prolong battery life.



5-year limited warranty



Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two-years labor reimbursement program coverage included for both the IQ Combiner SKUs
- UL Listed
- X2-IQ-AM1-240-4 and X2-IQ-AM1-240-4C comply with IEEE 1547:2018 (UL 1741-SB, 3rd Ed.)

IQ Combiner 4/4C

MODEL NUMBER	UNITS	DESCRIPTION
IQ Combiner 4 (X-IQ-AM1-240-4, X2-IQ-AM1-240-4)	—	IQ Combiner 4 with an IQ Gateway printed circuit board for integrated revenue-grade PV production metering (ANSI C12.20 ±0.5%) and consumption monitoring (±2.5%). Includes a silver solar shield to match the IQ Battery and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C, X2-IQ-AM1-240-4C)	—	IQ Combiner 4C with an IQ Gateway printed circuit board for integrated revenue-grade PV production metering (ANSI C12.20 ±0.5%) and consumption monitoring (±2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area). Includes a silver solar shield to match the IQ Battery and IQ System Controller 2 and to deflect heat.
WHAT'S IN THE BOX	UNITS	
IQ Gateway printed circuit board	—	IQ Gateway is the platform for total energy management for comprehensive, remote maintenance, and management of the Enphase Energy System.
Busbar	—	80 A busbar with support for one IQ Gateway breaker and four 20 A breakers for installing IQ Series Microinverters and IQ Battery
IQ Gateway breaker	A	Circuit breaker, 2-pole, 10/15
Production CT	—	Pre-wired revenue-grade solid-core CT, accurate up to ±0.5%
Consumption CT	—	Two consumption metering split core or clamp-type CTs, shipped with the box, accurate up to ±2.5%
Enphase Mobile Connect (only with IQ Combiner 4C)	—	4G-based LTE-M1 cellular modem (CELLMODEM-M1-06-SP-05) with a five-year T-Mobile data plan
MICROINVERTERS, ACCESSORIES AND REPLACEMENT PARTS (not included; order separately)	UNITS	
Supported microinverters	—	IQ6, IQ7, and IQ8. Do not mix IQ6/IQ7 Microinverters with IQ8
Enphase Communications Kit COMMS-CELLMODEM-M1-06	—	Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with a 5-year T-Mobile data plan for Enphase sites
CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	—	4G-based LTE-M1 cellular modem with a five-year T-Mobile data plan 4G-based LTE-M1 cellular modem with a five-year AT&T data plan
Circuit breakers (off-the-shelf)	—	Supports Eaton BR2xx, Siemens Q2xx and GE/ABB THQL21xx Series breakers (xx may be 10, 15, 20, 30, 40, 50, or 60). Supports Eaton BR220B, BR230B, and BR240B circuit breakers compatible with hold-down kit.
Circuit breakers (provided by Enphase)	—	BRK-10A-2-240V, BRK-15A-2-240V, BRK-20A-2P-240V, BRK-15A-2P-240V-B, and BRK-20A-2P-240V-B
XA-SOLARSHIELD-ES	—	Replacement solar shield for IQ Combiner 4/4C
XA-ENV2-PCBA-4	—	IQ Gateway replacement printed circuit board (PCB) for IQ Combiner 4/4C
XA-PLUG-120-3	—	Accessory receptacle for power line carrier in IQ Combiner 4/4C (required for EPLC-01)
X-IQ-NA-HD-125A	—	Hold-down kit for Eaton circuit breaker with screws
ELECTRICAL SPECIFICATIONS	UNITS	
Rating	A	80
System voltage and frequency	—	120/240 VAC, 120/208 VAC, 60 Hz
Busbar rating	A	125
Fault current rating	kAIC	10
Maximum continuous current rating (input from PV/storage)	A	64
Maximum fuse/Circuit rating (output)	A	90
Branch circuits (solar and storage)	—	Up to four 2-pole Eaton BR, Siemens Q, or GE/ABB THQL Series distributed generation (DG) breakers only (not included)
Maximum total branch circuit breaker rating (input)	A	80 A of distributed generation/95 A with IQ Gateway breaker included

To learn more about Enphase offerings, visit enphase.com.

IQC-4-4C-DSH-00217-3.0-EN-US-2024-08-16

Refer to the <https://enphase.com/installers/resources/warranty> page for country-specific warranty information.

© 2024 Enphase Energy. All rights reserved. Enphase, the e and CC logos, IQ, and certain other marks listed at <https://enphase.com/trademark-usage-guidelines> are trademarks of Enphase Energy, Inc. in the US, and other countries. Data subject to change.

IQC-4-4C-DSH-00217-3.0-EN-US-2024-08-16

RACKING SPEC SHEET




XR Rail® Family

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails® are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof penetrations, reducing the number of roof penetrations and the amount of installation time.

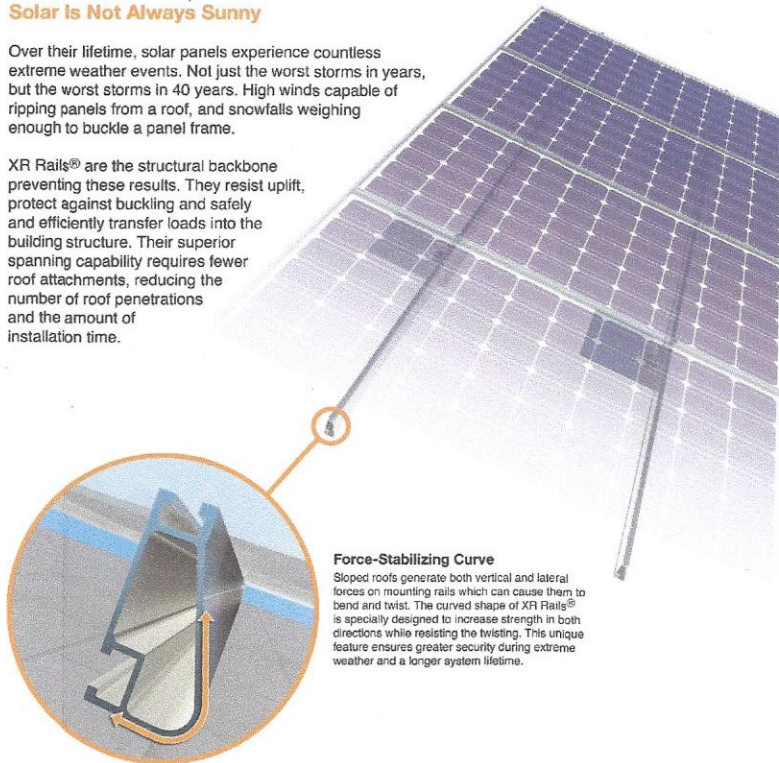

Force-Stabilizing Curve

Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails® is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

Compatible with Flat & Pitched Roofs



XR Rails® are compatible with FlashFoot® and other pitched roof attachments.



IronRidge® offers a range of tilt leg options for flat roof mounting applications.

Corrosion-Resistant Materials

All XR Rails® are made of 6000-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.



Tech Brief

XR Rail® Family

The XR Rail® Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail® to match.



XR10

XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 8 feet, while remaining light and economical.

- 6' spanning capability
- Moderate load capability
- Clear & black anodized finish
- Internal splices available



XR100

XR100 is the ultimate residential mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 10 feet.

- 10' spanning capability
- Heavy load capability
- Clear & black anodized finish
- Internal splices available



XR1000

XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.

- 12' spanning capability
- Extreme load capability
- Clear anodized finish
- Internal splices available

Tech Brief

Rail Selection

The table below was prepared in compliance with applicable engineering codes and standards.* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2e, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit IronRidge.com for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
None	90						
	120						
	140	XR10		XR100		XR1000	
	160						
20	90						
	120						
	140						
	160						
30	90						
	160						
40	90						
	160						
80	160						
120	160						

*Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance.


ATTACHMENT SPEC SHEET




The Respect Your Roof Deserves

When integrating with a home, solar attachments must be dependable for the lifetime of the rooftop. Due to recent innovations, many asphalt shingles have bonded courses. A mount that protects without the need to pry shingles can really speed things up.

Halo UltraGrip™ (HUG™) is here to respect the roof. Its Halo is a cast-aluminum barrier that encases the UltraGrip, our industrial-grade, foam-and-mastic seal. This allows HUG to accelerate the installation process and provide the utmost in waterproofing protection. Give your roof a HUG.™



UltraGrip™ Seal Technology
HUG UltraGrip utilizes a state-of-the-art seal design that uses a unique, foam-and-mastic combination. The foam-backed adhesive provides an entirely new flashing system that conforms and adheres to every nook and cranny of composition shingles, filling gaps and shingle step-downs (up to 1/8" in height).

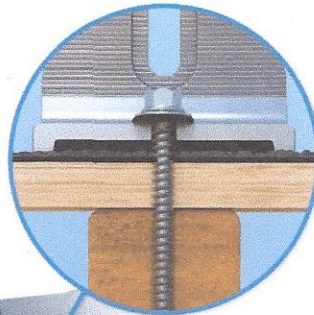

Multi-Tiered Waterproofing
HUG utilizes a multi-tiered stack of components to provide revolutionary waterproofing protection. The Halo cast-aluminum, raised-perimeter foundation surrounds the UltraGrip base—a foam-backed mastic seal combination that prevents water intrusion by adhering and sealing with the shingle surface.

Halo UltraGrip™ is part of the QuickMount™ product line.




Rafter & Deck Mounting Options
Mount HUG to the roof rafters, the roof deck, or both with our custom-engineered RD (rafter-or-deck) Structural Screw. The RD Structural Screw anchors HUG to the roof with an EPDM sealing washer, completing the stack of waterproofing barriers. See backside for more installation information.




Triple Rated & Certified to Respect the Roof™
UL 2703, 441 (27)
TAS 100(A)-95

Tech Brief


Adaptive, Rafter-Friendly Installation



Hit the rafter? Good to go!
When you find a rafter, you can move on. Only 2 RD Structural Screws are needed.




Miss the rafter? Try it again.
Place another screw to the left or right. If rafter is found, install 3rd and final screw.



Still no luck? Install the rest.
If more than 3 screws miss the rafter, secure six screws to deck mount it.

Tech Brief

Trusted Strength & Less Hassle

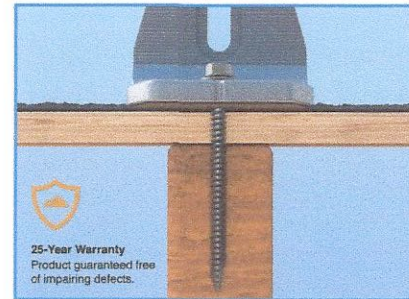

25-Year Warranty
Product guaranteed free of impairing defects.

Structural capacities of HUG™ were reviewed in many load directions, with racking rail running cross-slope or up-slope in relation to roof pitch.

For further details, see the HUG certification letters for attaching to rafters and decking.

IronRidge designed the HUG, in combination with the RD Structural Screw to streamline installs, which means the following:

- No prying shingles
- No roof nail interference
- No pilot holes necessary
- No sealant (in most cases)
- No butyl shims needed

Attachment Loading



The rafter-mounted HUG has been tested and rated to support 1004 (lbs) of uplift and 368 (lbs) of lateral load.

Structural Design



Parts are designed and certified for compliance with the International Building Code & ASCE/SEI-7.

Water Seal Ratings



HUG passed both the UL 441 Section 27 "Rain Test" and TAS 100(A)-95 "Wind Driven Rain Test" by Intertek.

UL 2703 System



Systems conform to UL 2703 mechanical and bonding requirements. See Flush Mount Manual for more info.