

System Requirements: Control System Summary

Project Name: FCPA Cunningham Park Tennis | Project #: 241496

Control System ID: 1 of 1

Distribution Panel Location/ID: Service 1 - TN

Project Information

Control System

Control System ID: 1 of 1
 Control System Type: Control-Link ® Control and Monitoring System
 Communication Type: PowerLine-ST

Project Notes:

Power Requirements

Control cabinet(s):

Control voltage (phase to neutral) 120/60
 VA loading - Inrush 1063.0
 VA loading - Sealed 128.0

Lighting Circuits:

Voltage/Hertz/Phase 240/60/1

Equipment Listing

Description	Qty	Size (in)
Control and monitoring cabinet - primary	1	24 X 48
Contactors, 30 amperes	2	-
Off/On/Auto switches	1	-
Push button switches	1	-
Strobe signal lights	1	-

Important Notes:

- Please confirm that the lighting circuit voltage listed above is accurate for this facility. This is the voltage/phase being connected and utilized at each lighting pole's electrical components enclosure disconnect. Inaccurate voltage/phase can result in additional costs and delays. Contact your Musco sales representative to confirm this item.
- In a 3 phase design, all 3 phases are to be run to each pole location. Musco's single phase luminaires come pre-wired to utilize all 3 phases across the entire facility.
- One contactor is required for each circuit at each pole location. Contactors are 3 pole and 100% rated for the published continuous load.
- If the lighting system will be fed from more than one distribution location, additional equipment may be required. Contact your Musco sales representative.
- Size overcurrent devices using the full load amps column of the Circuit Summary by Switch chart (Minimum power factor is 0.9). Size conduit per code unless otherwise specified as larger to allow for harness connectors.
- Avoid use of in-ground junction/pull boxes when possible. If used, the following best practices must be followed:
 - Underground handholes (pull boxes) must be supported to prevent settling. Boxes buried directly in soil, without support, are not allowed.
 - Use polymer concrete lids marked with ELECTRIC for underground handholes. Steel lids are not allowed.
 - Avoid underground connections when possible. If used, all wire connectors must be UL listed for Wet Locations to prevent leakage current.
- Control power wiring must be in separate conduit from line or load power wiring. Communication cables must be in separate conduit from any power wiring.
- Test wire per ANSI/NETA ATS-2021. Wires with insulation resistance less than 100 MOhms, in water-filled conduit, must be replaced.

System Requirements: Control System Summary

Project Name: FCPA Cunningham Park Tennis | Project #: 241496

Control System ID: 1 of 1

Distribution Panel Location/ID: Service 1 - TN


Important Notes:

9. Refer to Installation Instructions for more details on equipment information and the installation requirements.

System Requirements: Control System Summary

Project Name: FCPA Cunningham Park Tennis | Project #: 241496
Control System ID: 1 of 1
Distribution Panel Location/ID: Service 1 - TN

Equipment Layout and Connection Details

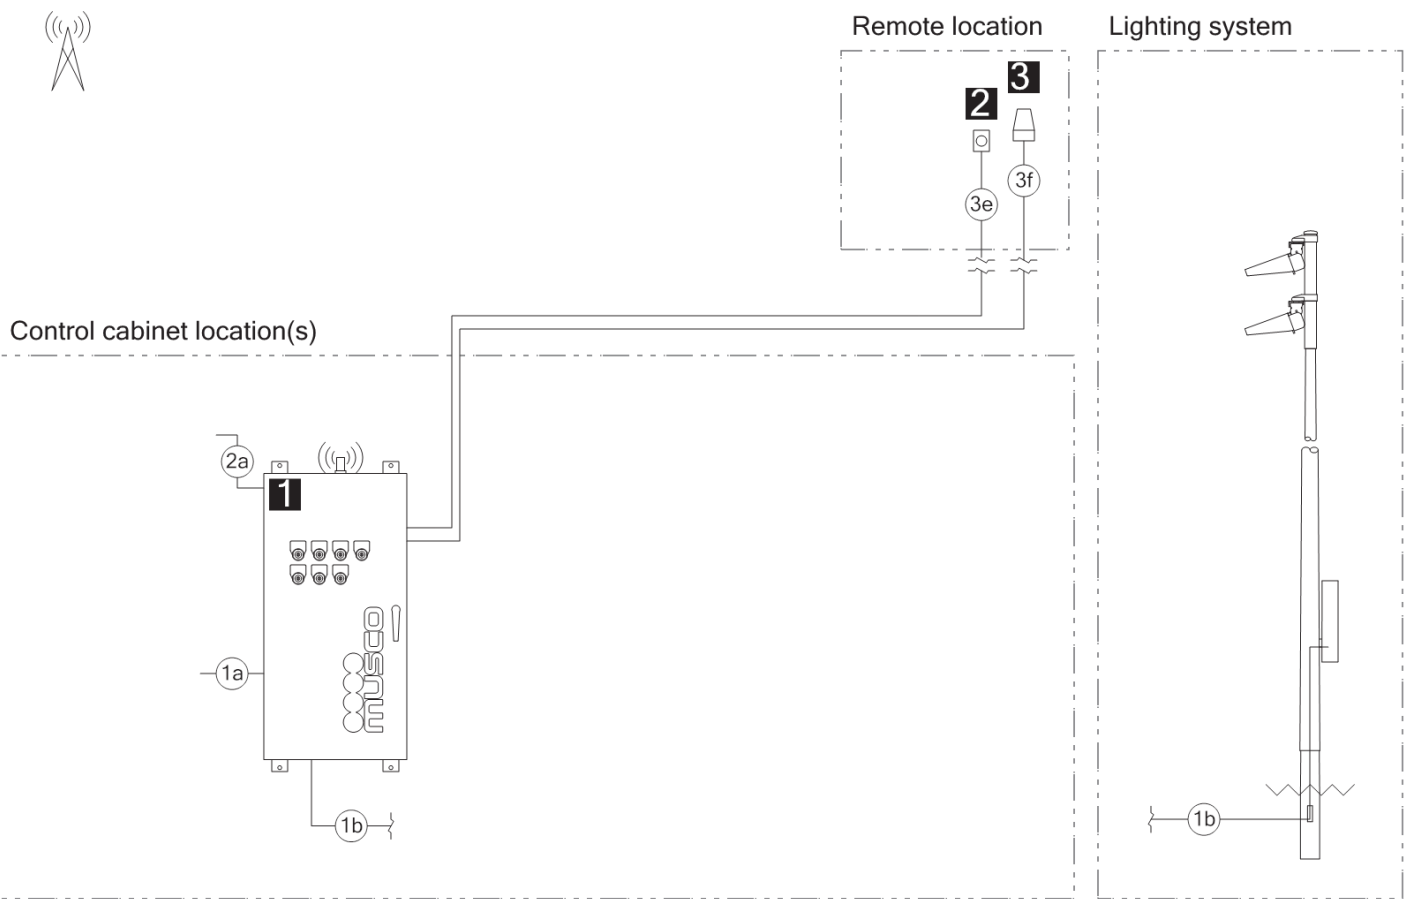

Connection Details		Equipment	
ID	Description	ID	Description
1a	Line power to contactors, and equipment grounding conductor. Requires one circuit per contactor, size wiring per load and voltage drop.	1	Control and monitoring cabinet - primary
1b	Load power from contactors, and equipment grounding conductor. Requires one circuit per contactor, size wiring per load and voltage drop.	2	Push button switches
2a	Control power with equipment ground to control cabinet. Requires dedicated 20 A circuit. Provide transformer if control voltage not present.	3	Strobe signal lights
3e	Control harness - Control cabinet to push button switch. Use 12 AWG copper conductor for up to 300 feet. Requires 2 conductors per push button.		
3f	Control harness - Control cabinet to strobe signal light. Use 12 AWG copper conductor for up to 300 feet. Requires 2 conductors per strobe light.		

System Requirements: Control System Summary

Project Name: FCPA Cunningham Park Tennis | Project #: 241496
Control System ID: 1 of 1
Distribution Panel Location/ID: Service 1 - TN

Circuit Summary

Switching Schedule	
Field/Switch Description	Switches
Tennis	1 ‡
‡ Push button control with strobe light.	

Control Module ID: 1

Lighting Circuit Voltage: 240/60/1

Circuit Summary by Switch							
Switch	Zone Description	Pole ID	Qty of Fixtures	Full load amperes	Contactor Size (Amps)	Cabinet #	Contactor ID
1	Tennis	T1, T4	4	11.08	30	1	C1
	Tennis	T2, T3	4	11.08	30	1	C2