


Town of Vienna

Approved

10/25/2021

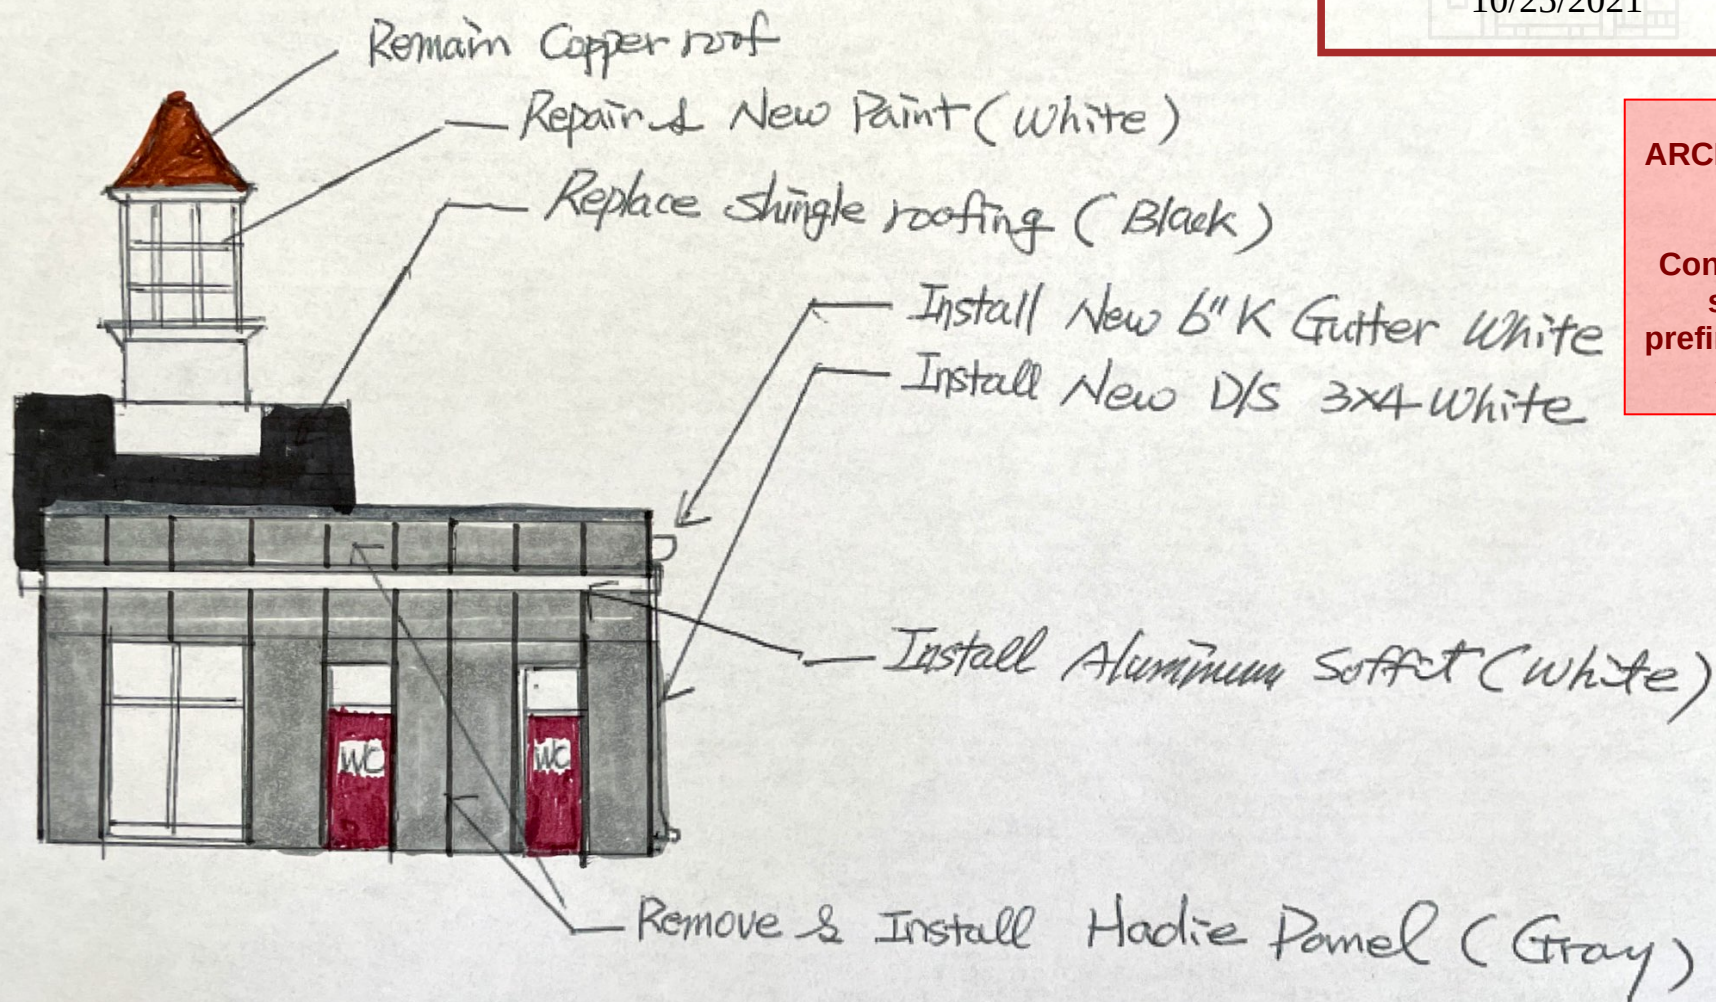

**BOARD OF
ARCHITECTURAL REVIEW
APPROVED**

October 21, 2021

**Conditions: Approved as
submitted with the
prefinished red material be
submitted to staff**

410 Maple Ave.,

Vienna VA

Gas Station


3/32

East

BOARD OF
ARCHITECTURAL REVIEW
APPROVED
October 21, 2021
Conditions: Approved as
submitted with the
prefinished red material be
submitted to staff

Town of Vienna
Approved

10/25/2021

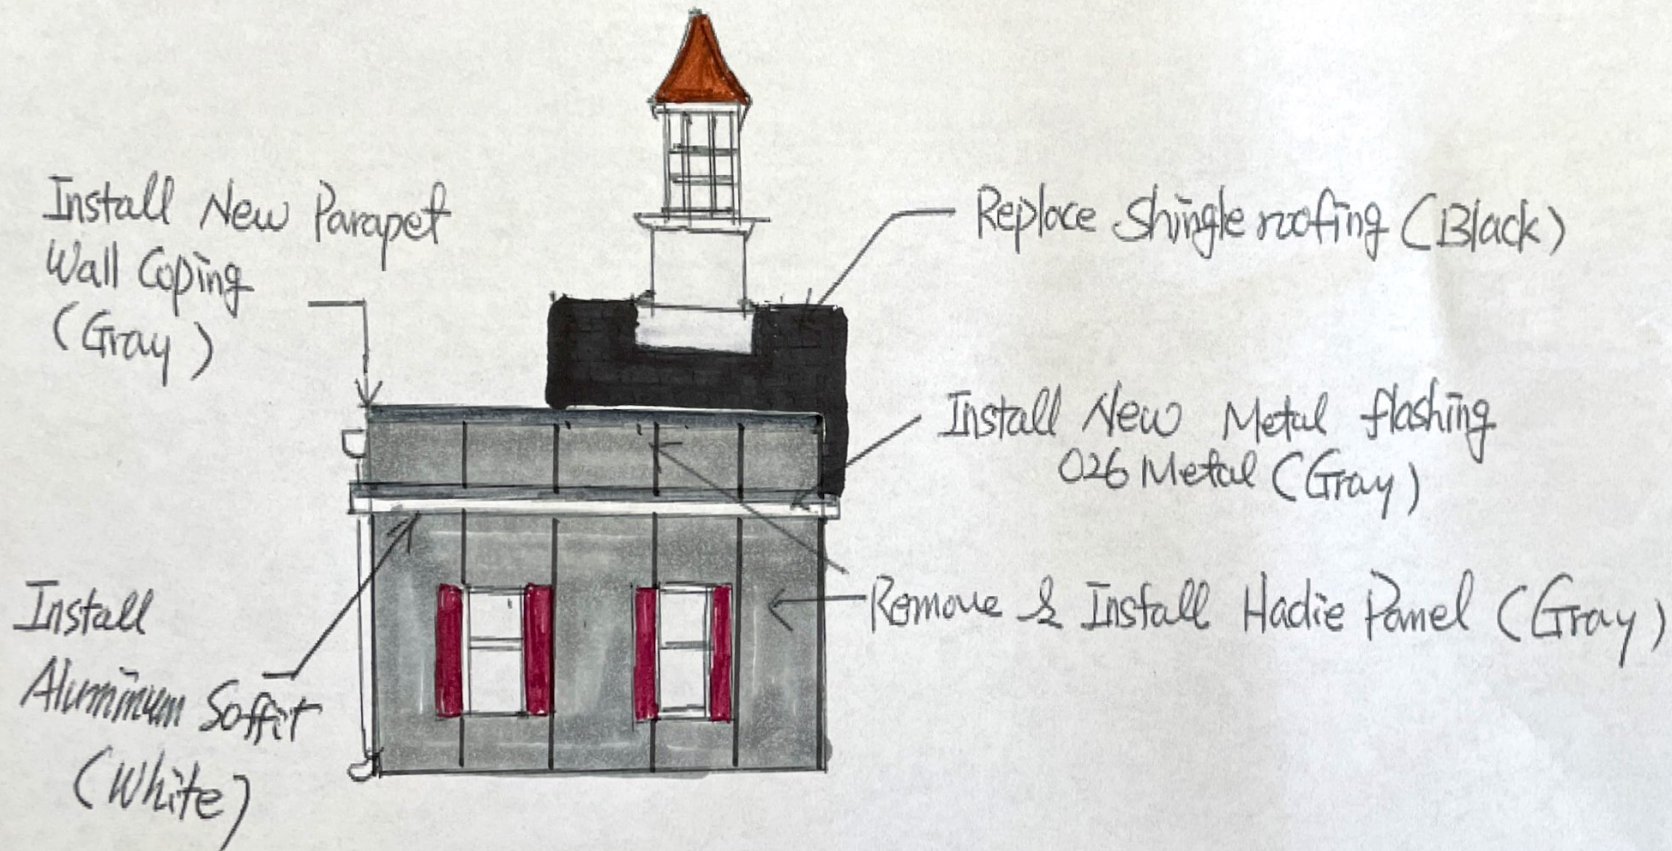

West

410 Maple Ave., E.
Vienna VA


Gas Station

3/32

BOARD OF
ARCHITECTURAL REVIEW
APPROVED
October 21, 2021
Conditions: Approved as
submitted with the
prefinished red material be
submitted to staff

Town of Vienna
Approved

10/25/2021

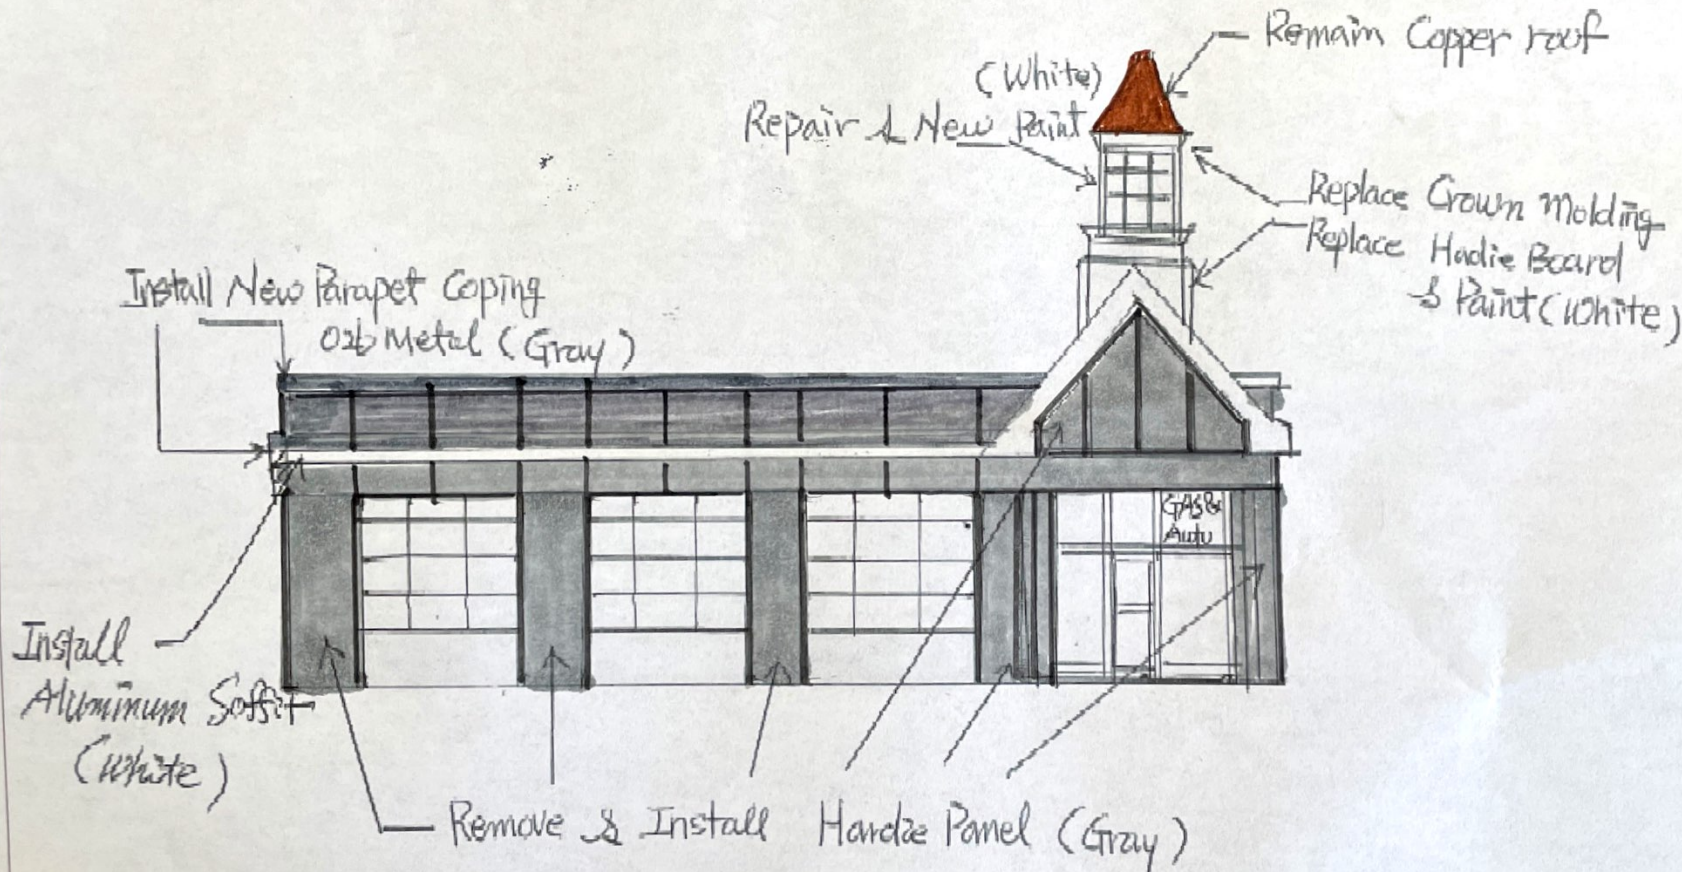

South

410 Maple Ave., E.
Vienna VA

Gas Station

3/32

Town of Vienna
Approved



10/25/2021

Everlast Metals

www.everlastmetals.com

**BOARD OF
ARCHITECTURAL REVIEW
APPROVED**
October 21, 2021
Conditions: Approved as
submitted with the
prefinished red material be
submitted to staff

Almond




Bone White

Sandstone

Sierra Tan

Slate Gray

Cityscape




Dark Gray

Charcoal

Slate Blue

Gallery Blue

Matte Black






Classic Bronze

Dark Bronze

Burnished Slate

Mansard Brown

Patina Green



Forest Green

Hartford Green

Terra Cotta

Burgundy

Colonial Red



◆ Premium Colors



◆ Regal Red

◆ Metallic Silver

◆ Metallic Copper

◆ Metallic Champagne

Gas Canopy

PLEASE NOTE: The colors listed on this color chart are as close to the actual painted metal as possible. Actual color swatches are available upon request. Fluropon® pre-finished galvalume steel and aluminum containing Fluropon® 70% PVDF.

Everlast Metals

Toll Free: 1.800.418.5057

Local: 717.389.0234

www.everlastmetals.com

Fluropon® Paint System	Steel		Aluminum		Technical Data							
Standard Finish - 35 Year Warranty	26 Ga.	24 Ga.	0.032	0.040	Energy Star®	LEED®	Initial TSR	Initial TE	Initial SRI	3 Year TSR	3 Year TE	3 Year SRI
Almond	•	•	•		•	•	0.56	0.83	65	0.65	0.83	77
Bone White	•	•	•	•	•	•	0.67	0.87	81	0.64	0.87	77
Burgundy	•	•	•		•		0.26	0.87	25	0.26	0.87	25
Burnished Slate	•	•	•	•	•	•	0.31	0.87	32	0.32	0.87	33
Charcoal	•	•	•	•	•		0.27	0.87	27	0.28	0.87	27
Cityscape	•	•	•	•	•	•	0.38	0.87	42	0.39	0.87	30
Classic Bronze		•	•	•	•		0.11	0.83	41	0.25	0.83	22
Colonial Red	•	•	•	•	•	•	0.29	0.88	30	0.29	0.88	30
Dark Bronze	•	•	•		•	•	0.29	0.88	30	0.30	0.88	30
Dark Gray	•	•	•	•	•	•	0.34	0.88	36	0.34	0.88	36
Forest Green	•	•	•	•	•	•	0.32	0.87	33	0.32	0.87	33
Gallery Blue	•	•	•	•	•	•	0.30	0.87	31	0.30	0.87	31
Hartford Green	•	•	•	•	•	•	0.29	0.88	30	0.29	0.88	30
Mansard Brown	•	•	•	•	•	•	0.28	0.89	29	0.29	0.89	30
Matte Black	•	•	•	•	•		0.26	0.87	25	0.26	0.87	25
Patina Green	•	•	•	•	•	•	0.28	0.89	29	0.28	0.89	29
Sandstone	•	•	•	•	•	•	0.40	0.87	44	0.40	0.87	44
Sierra Tan		•	•	•	•	•	0.54	0.87	63	0.53	0.87	62
Slate Blue	•	•			•	•	0.52	0.87	60	0.51	0.87	59
Slate Gray	•	•	•	•	•	•	0.34	0.88	36	0.34	0.88	36
Stone White		•			•	•	0.43	0.87	48	0.43	0.87	48
Terra Cotta		•			•	•	0.62	0.88	74	0.59	0.88	70
Galvanized G90 Acrylic Coated	•	•										
Galvalume® AZ55 Acrylic Coated	•	•										
Mill Finish			•	•								
Premium Finish - 35 Year Warranty												
Regal Red	•	•	•		•	•	0.49	0.88	56	0.49	0.88	56
Metallic Champagne		•			•	•	0.41	0.87	46	0.38	0.91	43
Metallic Copper		•	•		•	•	0.37	0.87	41	0.43	0.90	50
Metallic Silver		•	•		•	•	0.54	0.87	64	0.46	0.91	53

Polyester Paint System	Steel		Aluminum	
Standard Finish - 10 Year Warranty	26 Ga.	24 Ga.	0.032	0.040
Bronze/White			•	
Medium Bronze/Bronze			•	
Black/White			•	
White/White			•	

- Oil canning is not a cause for rejection.
- Protective film must be removed immediately after installation.
- For a true color representation, please call or write for actual metal sample(s).
- Contact your local sales representative for specific stocking information and special requests.

LEED 2.2 Requirements

Solar Reflectance Index (SRI)

Steep Slope Roofs = ≥ 29

Low Slope Roofs = ≥ 78

ENERGY STAR Requirements

Initial Solar Reflectivity

Steep Slope Roofs ($>2:12$) ≥ 0.25

Low Slope Roofs ($\leq 2:12$) ≥ 0.65

3 Year Solar Reflectivity

Steep Slope Roofs ($>2:12$) ≥ 0.15

Low Slope Roofs ($\leq 2:12$) ≥ 0.50